

# Reliability and Operations Management Applications in Olefins Plants

Jack Stout - Nexus Engineering, Inc.  
[jstout@nexusengineering.com](mailto:jstout@nexusengineering.com)

Presented at the AIChE Spring National Meeting  
Houston, Texas, April 26-27, 2001

## Introduction

Initially applied to narrowly focused applications in chemical plants, rules and procedural-based software technologies are now being deployed for reliability and operations management applications in olefins plants to provide a broad range of operational benefits. Unlike other mature process industries with aging plants and facilities, today's olefins plants are typically the result of the newer process technologies built or revamped over the last fifteen years and positioned to quickly deploy the newer automation technologies. The newer units have the open architecture control systems and digital instrumentation to form the infrastructure for the high return advanced automation applications.


The current generation of plant management has built their careers on leveraging the new process and automation technologies for competitive advantages. The investments in advanced control applications are no longer based on if the applications will work, but on where should they be applied to deliver the maximum return on investment. The plant operations philosophy has shifted from merely running the unit, to the management of the process operations.

## Automation as a Competitive Strategy

Although olefins plants are deploying the various automation technologies, they are being deployed at different rates. Some companies are pursuing optimization while others are still deploying the multivariable controller applications. As new technology becomes viable, it is eventually deployed throughout the industry. As a result, today's breakthrough technology becomes tomorrow's basic automation platform.

Among the olefins producers, there is a "pace setter" group comprised of the top performers, typically leading in a number of performance metrics in addition to automation.

## Industry Automation Trends

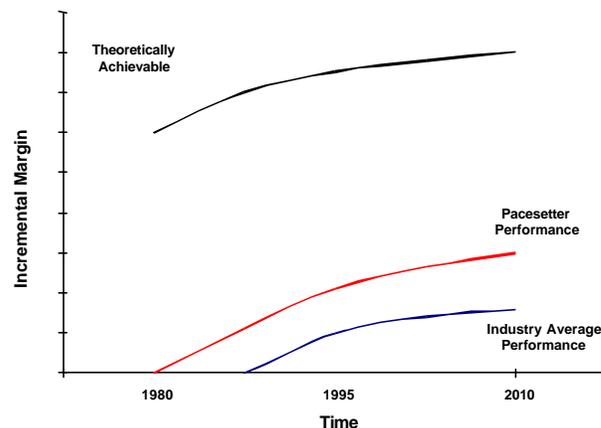

The progression of deployed technologies contributes to the continual improvement in the median performance levels the olefin plants. Companies with moderate investment strategies merely remain even in their industry position, while those with flat investments fall behind. The migration of this performance baseline is the driver behind the early validation and rapid deployment of the emerging automation technologies, providing a competitive advantage. The contribution to the company's performance relative to its industry peers is dependent upon how quickly the benefits were realized before they became the new base level of automation.

### **Emerging Issues**

New issues have emerged as companies became experienced with the automation technologies. The applications provided the expected benefits but exposed critical automation areas that remained un-addressed. The automation areas now being addressed are the Reliability & Operations Management (R/OM) applications.

### **Reliability Issues**

The availability of operations performance information from the initial information and control projects increased management's awareness of actual operations economics. This improved understanding of the plant operations generated initiatives to improve the plant's reliability and safety. The initial reliability initiatives were focussed on the maintenance and mechanical integrity of the equipment because the organizations driving these initiatives were more familiar with these aspects of the client's business.

With recent benchmarking data indicating that approximately 70% of reliability issues are process induced with the other 30% being mechanically induced<sup>(1)</sup>, the plant reliability groups are now expanding their initiatives to address asset utilization and process reliability. The reliability focus has enabled the sites to identify the historical performance, but has done little to provide the real-time assessment of the issues in time for them to be impacted by the operations personnel. The issues were typically identified after the damage was done.

### **Operations Issues**

The newer distributed control systems (DCS) and the advanced control applications provided a wide range of benefits over the earlier operations environments, but they also created new operational issues:

- Operators initially were responsible for 30-50 loops with the older panel board with single loop controllers. The newer distributed control systems increased the typical loop counts to 100-125 per operator. The addition of the advanced control applications enabled the loop counts to climb to more than 200 and in some cases over 350 loops per operator.
- Extensive alarm annunciation at predetermined points within the instrument range.
- Providing a platform for value added technologies such as multivariable control and real time optimization.

Unfortunately, these strengths often make it more difficult to identify the root cause of process problems and develop appropriate responses. This has resulted in a less than optimal reliability factor for most processing facilities. Factors affecting this decline in reliability are:

- DCS alarms are typically limited to monitoring specific parameters at pre-assigned levels within the operations range. While this level of parametric alarming is important, it doesn't provide the complete picture of the problem. A more process focused diagnostics system is needed which correlates data to identify problems early in their severity level.

- Pre-defined alarm limits must be configured appropriately to prevent nuisance alarms over the full range of operation. Very little attention is given to performing diagnostics within the “normal” operating range. Examples of where this causes problems are frozen or hung transmitters, or deviations within range that affect associated control loops.
- The parametric alarming function provides cryptic descriptions of the upset condition (“FIC101 High”). Operators waste time deciphering these alarms rather than focusing on taking the appropriate corrective actions.
- A larger concern is the very common occurrence of alarm flooding whereby the operator receives excessive information about follow-on incidents. The operator is not provided with an indication of the root cause of the process problem. The operator must sort through the alarm information to discern what’s actually happening, typically with inconsistent interpretation of the information.
- Very little information is provided to the operator on how to respond to process disturbances. When a disturbance occurs, the operator is immediately put into a reactionary mode. They must troubleshoot the problem and develop a solution. The Operators experience level, alertness, and the way information is presented limit the degree with which operators can identify the problem and develop the correct response.
- The operator’s scope of responsibility also increased with the increasing loop counts. Now the operator was responsible for not merely an entire unit, but multiple units, each with unique characteristics. The addition of the advanced control applications simplified the operators’ interactions with the units during normal operations, but left the operator exposed when direct interaction with the control system was required during process upsets.

In response to the consequences of some of these issues, regulatory agencies required additional documentation on the process equipment, operating procedures, chemical compositions, and critical failure scenarios. The process safety initiatives generated additional information on the process units without addressing how the operations personnel could access and benefit from the information during a process upset.

- Detailed problem definitions and action procedures resident in PSM documents are not effectively integrated into the operators’ job function. Little has been done to position the information captured in OSHA mandated documentation to operators in an effective fashion. This investment and intellectual capital generally sits on the shelf and is not used effectively to make money for the organization.
- The improved performance analysis available through the information and control systems enabled companies to identify significant variations in the operations practices between shifts. The focus on “best practices” identified the need for operations tools to promote consistent procedure execution by the operations personnel but there was not a mechanism to deploy the information. Intellectual capital resident in experienced operations and engineering staff is not being captured. Further, there is no way to deploy this intellectual capital across shifts let alone across multiple plant assets.

These deficiencies in current automation technology result in the operator being unable to effectively manage upset conditions, nor operate the plant for maximum profit contribution.


## Emerging Technologies

As the control and information technology applications have become mainstream in the industry, expert system technologies are now emerging to address the middle-ware automation requirements. The rules & procedural-based reasoning and inferential logic features inherent to expert systems technology are providing the core functions to a range of applications, facilitating the management of data between the information and control domains. Companies are now able to leverage from expert systems to implement more sophisticated and higher return applications on their existing control and information system infrastructures. The automation areas now being addressed are the use of expert systems in Reliability & Operations Management applications (R/OM).

The R/OM applications are based on an expert system architecture to utilize the rules and procedures to provide the automation functions undeliverable by the advanced control and optimization applications. The knowledge-based rules incorporated into the system enable the operator to benefit from the unit operations information contained in the operating procedures in addition the contributions of the most experienced operations and engineering personnel.

## System Architecture

The system architecture uses industry standards such as Ethernet networks, PC Workstations, Windows NT operating system, and OPC bridges to provide a high performance system integrated with the existing control system. The use of the industry standard applications, bridges, and objects enables the application to integrate with legacy applications and systems while providing a consistent operations interface through the operator's control system consoles.

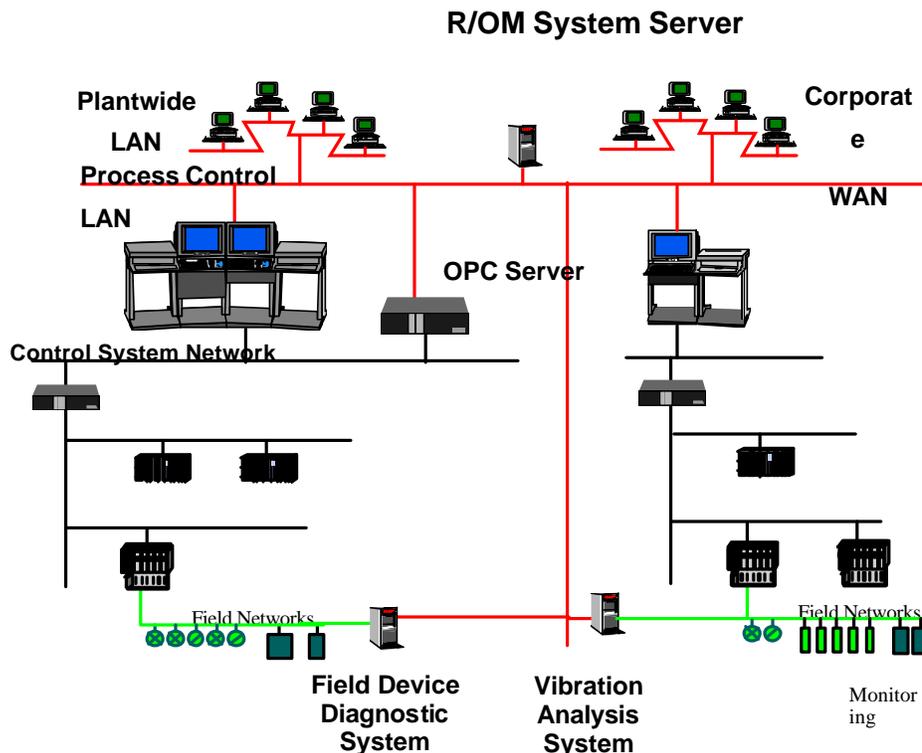

The architecture of the R/OM system addresses the production management domain of the console operator, while also integrating with applications to support the planning & scheduling, maintenance, and engineering personnel. Integrating the document management systems, plant historian, equipment diagnostics server, and fieldbus server enables the R/OM system to perform diagnostics across multiple systems. The integration with the wide area network or the remote access server enables the applications to be deployed and maintained from remote locations or with the client's centralized support groups.

The standards-based architecture supports the integration of the system with other applications to yield a consistent operations interface at the control system console. The result is an operations support system which enables the operator to identify, assess, decide, and respond to process upsets faster and more correctly than with the standard control system.

### ***Reliability & Operations System Functions***

The R/OM system takes a process level view of the diagnostics function. Rather than focus on electrical connections, and annunciation at pre-defined alarm limits, the system:

- Evaluates the health of the process on a real time basis.
- Identifies the root cause of process problems early (before the DCS alarm is activated).
- Couples diagnosis of the problem with a suggested action response to avoid the upset entirely.
- Provides advisory messaging to minimize the effects of upsets that do occur.

Components of the R/OM System diagnostics package are as follows:

- Sensor validation – Algorithms supplement the sensor validation functions of the DCS by monitoring for changes within alarm limits, limit excursions, blips, spikes, and most importantly, dead sensors.
- Cascade loop monitoring – Monitors the variation between the “remote set points” and “process variables” for cascade loops. A deviation in this relationship could indicate a need for tuning of the loop or uncover an upstream process problem.
- Control loop modeling – Models the relationship between the “process variable” and “output” of all control loops. This allows windup conditions to be detected.
- Process data correlation – This function allows calculated values to be compared with actual signals to provide additional validation. For example, the level in a tank can be compared with a calculated value based on inflows, outflows, and tank volume. Or analyzer values can be correlated against the expected calculated values based on operating conditions.

The R/OM System diagnostics package adds value by identifying the problem early and coupling the diagnostics with advisory messaging to allow the operator to focus on corrective actions rather than process troubleshooting.

The operations management applications also address process unit level functions by monitoring for operating conditions that would adversely impact production. These rules are based on the standard operations procedures for the units, first principal models, and the accumulated “best practices” knowledge of the operations personnel. Examples of these diagnostics are:

- Operations Diagnostics - Distillation Column Flooding, Furnace Over Firing, Catalyst Poisoning, Filter Plugging, etc.

- Operational Changes - Feed Composition, Cooling Water & Air Temperature, Foaming, Plugged (Frozen) Pipes, Fuel Quality, etc.
- Utilities Failures - Electrical, Air, Cooling Water, Steam, Fuel Gas, etc.
- Equipment Failures - Pumps, Compressors, Heat Exchangers, Furnaces, columns, etc.

The R/OM system requirements are based on a hierarchy of requirements starting with sensor validation. At the basic level the sensor validation consisted of data analysis for the high/low limit checking, “blipped”, “dead”, and simple model inferences. Another benefit of the sensor validation is realized when the R/OM system is integrated with other applications such as the multivariable controls (MVC). Although most of the current MVC implementations use some form of data reconciliation to check the process data, they are still vulnerable to the process upsets propagated by the inappropriate control response to a dead sensor. The demand for more rigorous sensor validation is increasing with the proliferation of the MVC applications as users strive to maintain the high service factors on which the applications were justified. The integration of the enterprise applications is creating additional demand for the sensor validation as the consequences of erroneous process data extend beyond the process unit or the site to the corporation.

The more advanced features of the system address fundamental chemical engineering principals, operational heuristics, and the data response patterns. Although the benefits of the production management applications can be very significant, the real benefits of the system are in the reduction of process upsets. The benefits of the advanced control applications are based on incremental improvements to the process operation over long runtimes, high unit capacities, and high application service factors. A week of unscheduled downtime will cost the refinery more than a year’s worth of advanced control benefits. Process manufacturing companies are learning that the management of their abnormal situations provides greater benefits than their advanced process control (APC) applications by addressing a more fundamental function, keeping their process units running. Unlike the advanced control applications, the R/OM applications are targeting the reduction in unit downtime, which represents a total loss of production.

The operator advisory components provide the messaging and alarm management for the process analysis performed by the expert system rules. Clients have invested a significant amount of knowledge-engineering effort and time in the development of these procedures in response to the OSHA process safety management initiatives. Incorporating this information into the operator advisory system would enable the documents to be more effectively accessed by the operators, during the abnormal operating situations, when they were needed most. The integration of the emergency response procedures enhances the operator’s interface by presenting the appropriate procedure for a detected abnormal situation in real-time. The system has established a new “best practices” by providing a management of change environment for the OSHA required documents. The ability for the operator to effectively use and provide feedback for the documents is improving the quality of the documents and, more importantly, the value to the operations personnel.


### **Operations Scenarios**

An operator with a conventional control system is usually first aware of a process event when a process value has exceeded a predefined alarm limit, generating an alarm in the control system. The alarm may be specific to a single parameter issue or it might be one of many alarms.

The operator must then assess the alarms to determine what has occurred before deciding on the appropriate action. Assuming that the operator correctly assesses the situation, understands the numerous response possibilities, and decides to take the “best action”; the

operator will then initiate a corrective response. Meanwhile the severity of the problem has escalated and a flood of alarms associated with subsequent, follow-on problems occur. The operator is left to discern what is actually happening, what caused the problem, and what is an appropriate response.

### Traditional DCS Response

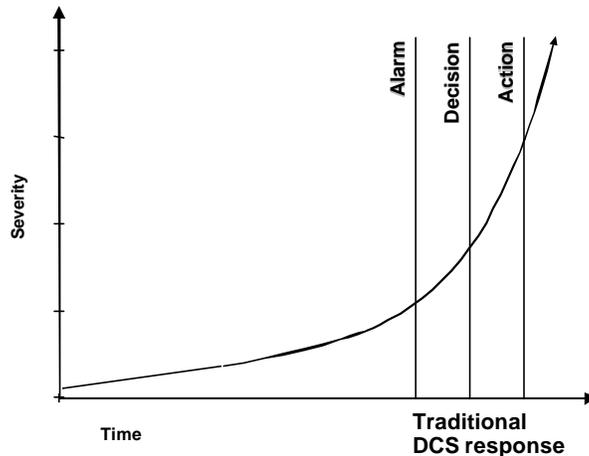


This is a simplified view of the operator's world. The "real world" scenario is that there are numerous other alarms on the control system at the same time. The operator may have observed the problem before, or may have heard about it occurring on another shift. The corrective response may have been recorded in the standard operations procedure for the unit, or in the emergency response procedures. The operator may decide to look-up the information either electronically or in the binder of documents stored near the control console, if this particular upset has been clearly referenced and documented. With time ticking away, the severity of the upset has continued to progress from merely an alarm condition toward a more severe condition. The operator is now responding to a more elevated situation over the initial alarm with process operation consequences of varying impacts.

The R/OM system takes a different approach by detecting process events before they reach the alarm conditions on the control system. The system monitors the status of the instrumentation, equipment, and the process unit operations. The sensor validation will identify suspect values before they can escalate into the larger process upsets. Before the control system experiences the alarm, a controller has gone out of control or reached its limit of control, permitting the process to move to an undesirable condition. If the operator or the operations engineer were closely monitoring that particular area of the process, they may have been able to observe and respond to the problem before the process triggered a limit alarm on the control system. In the "real world", the operator's scope of responsibilities does not permit them to scrutinize the unit operations at this level.

As the operator selects the advisory message displayed on the control system console, the trended information related to the detected failure and the emergency response procedure are automatically displayed, advising the corrective action required. The diagnostics and suggested responses are presented to the operator in a clear, concise, fashion using descriptive language. Should the operator require additional information relative to the explanations and response procedures for an event or equipment type, the system automatically displays the appropriate OSHA documentation and highlights the correct response advisory text. The

documents can be process safety management documents, material data safety sheets, HAZOPS procedures etc. The significance of this function is that the R/OM system fully leverages the client's investment in OSHA regulatory compliance and environmental health and safety initiatives.

### R/OM System Response

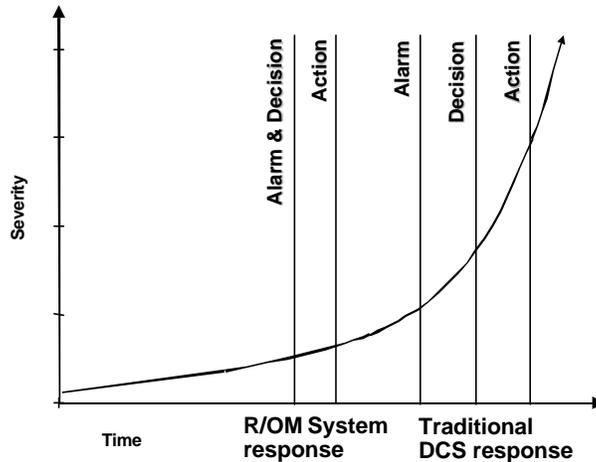

At the more advanced diagnostic levels, the rules in the system monitor for the symptoms that would indicate imminent process upsets of a more significant scale such as distillation column flooding, over-firing a furnace, blocking in a running pump, catalyst poisoning, etc.

### Benefits / Case Study

The R/OM system diagnoses process problems and couples operator advisory messaging to avoid process upsets. Further, the system captures the best practices of operations, engineering and management staff and allows this knowledge to be deployed to operators on a 27/7 basis. The result is increased process uptime and reduced incidents, which expose personnel and the environment to potentially hazardous situations. Benefit areas the package addresses includes:

**Process Availability** – The R/OM system diagnoses reliability incidents and couple an appropriate operator response to avoid the upset condition and resulting downtime. This is especially important for those plants that have to deal with operator turnover and the resultant inexperienced operator responses.

Advanced automation technologies such as APC and optimization have led to longer run times, and fewer process upsets, whereby operators are often ill equipped to handle problems when they do occur.

One olefins manager recently commented that operators could even forget how to run the plant on a seasonal basis. More importantly, this manager commented on the amount of management support required to start-up his unit. They see a great benefit in being able to capture operations know-how, and deploy it across the operations staff, to facilitate smoother startups.

**Environmental, Health, and Safety** - The R/OM system will provide the right information, and guidance, to allow the operations staff to diagnose process problems and respond in a safe and orderly fashion.

As an example of how the system will address this key benefit area, a large ethylene complex recently experienced a power outage on one of their units. The operator of a nearby unit started receiving alarms at a rate of 60 alarms per minute. The operator acknowledged all the alarms including key alarms that should not have been acknowledged. A furnace fire ensued which put personnel in jeopardy and resulted in significant losses. The R/OM system would have:

- Ignored the alarms coming from the unit which was down
- Identified the root cause of the problem
- Focused the operators attention on those alarm conditions which mattered most
- Suggested an appropriate response to avoid the catastrophe.

**Increased production** - The R/OM system advisory enables the operator to push production through the management of abnormal conditions as well as providing the guidance to allow operators manage the multivariable control applications. Operators are able to manage the process operations to operate closer to the correct constraints.

**Intellectual Property Management** - In a recent example, key supervisors were preparing to retire from a client's plants. The personnel were involved with the knowledge engineering phase of a R/OM project contributing to the definition of diagnostics to facilitate how they managed the process operations. These procedures were transposed into the R/OM System knowledge base and commissioned on the process unit. The client has not only retained the expertise of their best operations personnel, but they have also provided a mechanism to impart this experience to benefit junior level operations staff.

The intellectual capital captured during the knowledge engineering phase is then available to support consistent operations across shifts and across the client's asset base. This allows the operations philosophy of an organization to be propagated globally to facilitate consistently profitable operations and allow for support from a central location.


**Economic Benefits** - A recent feasibility study on a 1.0 Blb/yr. Olefins unit developed with a client indicate that process induced reliability issues for the first six months of last year resulted in losses of approximately \$2.5 million. The losses for the remainder of the year were estimated to be an additional \$2.0 million. These losses were not the total losses, but those that would have been addressed by the functionality of a R/OM system. The losses are attributable to downtime and equipment repair costs and other miscellaneous problems with the unit.

A second study with another olefins client showed that the deployment of the R/OM system would have addressed key safety issues and resulted in an increase in profitability of \$5.4 million dollars over a thirteen-month period. Further analysis of the incident data indicated the application would have provided a 3-month payback by avoiding the first 3 incidents during that same time period. The reliability losses for 2000 were expected to exceed an additional \$4.0 million dollars.

## **Conclusion**

Although the applications are considered to be an emerging technology, the initial R/OM systems have been online for more the eight years. The demonstrated performance of these applications has established the viability of the technology, system architecture, and the project methodology.

## Industry Automation Trends

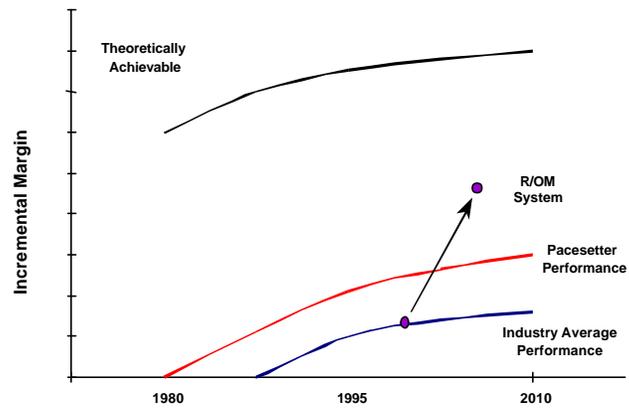

Additional systems are now underway with other major companies as the industry's benchmark automation is moved to a higher level. Companies are now pursuing R/OM strategies to realize a step change in the benefits over their competitive companies.

(1) Olefin Plant Reliability – 2/2000, George S. Birchfield, Solomon Associates